

SPECIFICATION SUBMITTAL SHEET



FEATURES

Sizes: 3/8" 1/2" 3/4" 1"

Maximum working water pressure 150 PSI
 Maximum working water temperature 180°F
 Hydrostatic test pressure 300 PSI
 Threaded connections ANSI B1.20.1

Replaceable thermoplastic modular cartridge
 Spill resistant feature for indoor use

OPTIONS

(Suffixes can be combined)

- with full port QT ball valves (standard)

ACCESSORIES

- Repair kit (complete)
- Repair kit (rubber only)
- Water hammer arrester (Model 1250)
- QT-SET Quick Test Fitting Set

DIMENSIONS & WEIGHTS (do not include pkg.)

MODEL SIZE		DIMENSIONS (approximate)						WEIGHT	
		A		B		C			
in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg
3/8	9	5 5/16	135	3 1/8	79	3 3/8	86	2.0	0.91
1/2	15	5 11/16	144	3 3/8	86	3 3/4	95	2.1	0.95
3/4	20	7 1/2	190	4 1/4	108	4 1/2	114	3.8	1.72
1	25	7 15/16	200	5	127	5	127	5.0	2.27

APPLICATION


Designed for installation on indoor and outdoor point of use applications to protect against backsiphonage of contaminated water into the water supply. During start-up and operation a separate diaphragm seals the air inlet from the water supply preventing spillage. The assembly is designed for use under constant pressure and provides protection where a potential health hazard exists.

STANDARDS COMPLIANCE

- ASSE® Listed 1056
- IAPMO® Listed
- CSA® Certified
- Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California


MATERIALS

Main valve body Cast Bronze ASTM B 584
 Elastomers Silicone (FDA Approved)
 Buna Nitrile (NSF Listed)
 Polymers Polypropylene (FDA Approved)
 Delrin™ (NSF Listed)
 Springs Stainless Steel, 300 Series

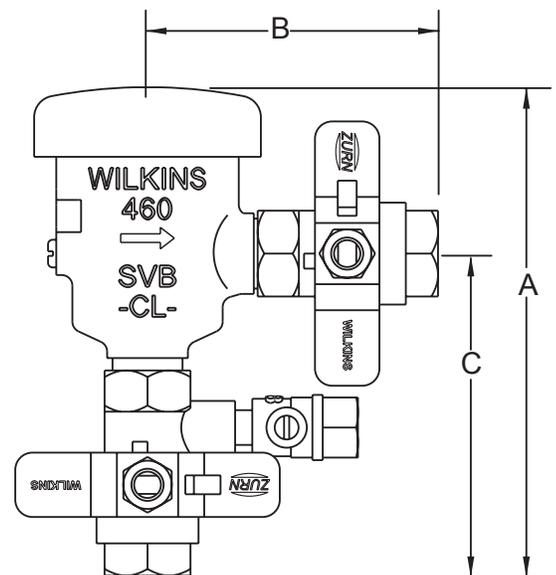


FLOW CHARACTERISTICS

MODEL 460 3/8" & 1/2" (STANDARD & METRIC)

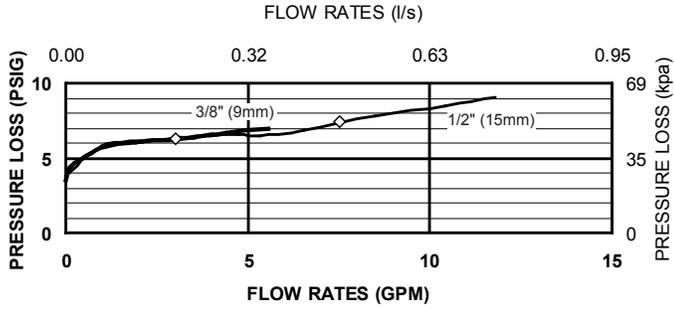

MODEL 460 3/4" & 1" (STANDARD & METRIC)

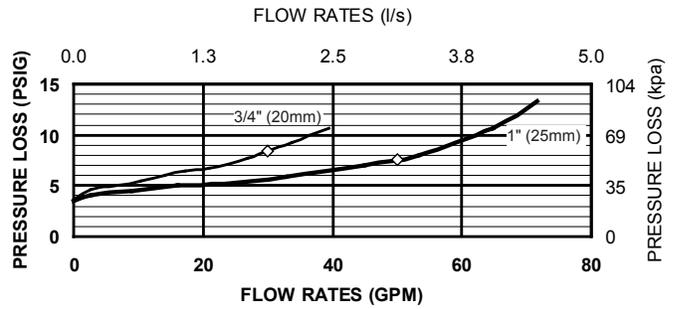


◇ Rated Flow (Established by approval agencies)


TYPICAL INSTALLATION

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be installed in accordance with the manufacturers' instructions and the latest version of the Uniform Plumbing Code. The critical level mark on the assembly shall be mounted at a minimum of 12" (305mm) above the highest downstream piping or outlet. Install with sufficient side clearance for testing and maintenance. The installation shall insure that no part of the assembly can be submerged. A spill-resistant pressure vacuum breaker cannot be installed where back-pressure could occur.

Capacity thru Schedule 40 Pipe				
Pipe size	5 ft/sec	7.5 ft/sec	10ft/sec	15ft/sec
1/8"	1	1	2	3
1/4"	2	2	3	5
3/8"	3	4	6	9
1/2"	5	7	9	14
3/4"	8	12	17	25
1"	13	20	27	40
1 1/4"	23	35	47	70
1 1/2"	32	48	63	95
2"	52	78	105	167

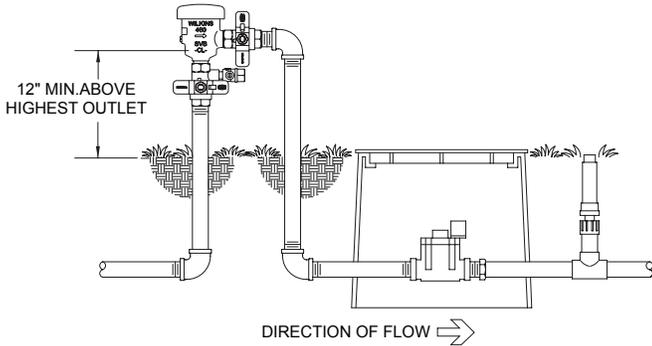

OUTDOOR INSTALLATION

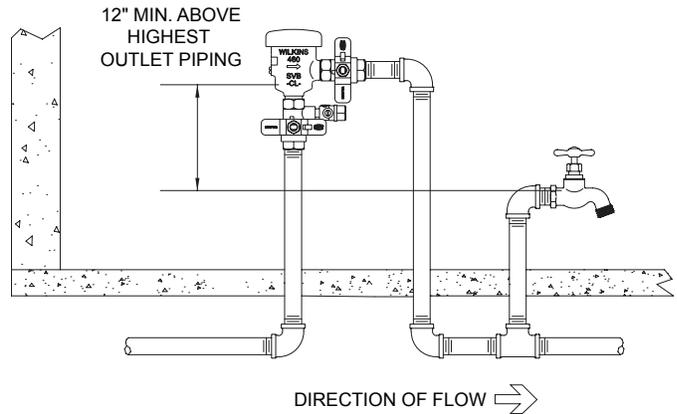

INDOOR INSTALLATION

SPECIFICATIONS

The Spill-Resistant Pressure Vacuum Breaker shall be ASSE® 1056 Listed, and supplied with full port ball valves. The assembly shall utilize a bronze (ASTM B 584) main body and an integrated modular check and float assembly made from thermoplastics. Springs shall be stainless steel. The valve shall incorporate a diaphragm to separate the air inlet from the potable water supply preventing spillage. The Spill-Resistant Pressure Vacuum Breaker shall be a Wilkins Model 460.